

NOTE:  
THIS DRAWING INDICATES AND ASSUMES THE USE OF  
BPT COMPOSITE CABLES OR A SUITABLE EQUIVALENT.

ENSURE ALL ADDITIONAL CONNECTIONS ARE  
A MINIMUM OF 0.5MM CSA PARALLEL CONDUCTORS.

INCORRECT CABLE SPEC CAN CAUSE DIGITAL  
SIGNALING PROBLEMS.


NOTE: CABLE EQUIVALENTS

VCM/130 = RG59 COAX + 4 CORES @ 1.0MMSQ + 8 CORES @ 0.5MMSQ

VCM/60 = RG59 COAX + 2 CORES @ 1.0MMSQ + 3 CORES @ 0.5MMSQ

75 Ohm  
ENSURE LAST VAV/400P IN/OUT  
BLOCK HAS A 75 Ohm RESISTOR  
FITTED ACROSS TERMINALS 3 & 4.

TO FURTHER MONITORS AND  
CD/204 AS REQUIRED

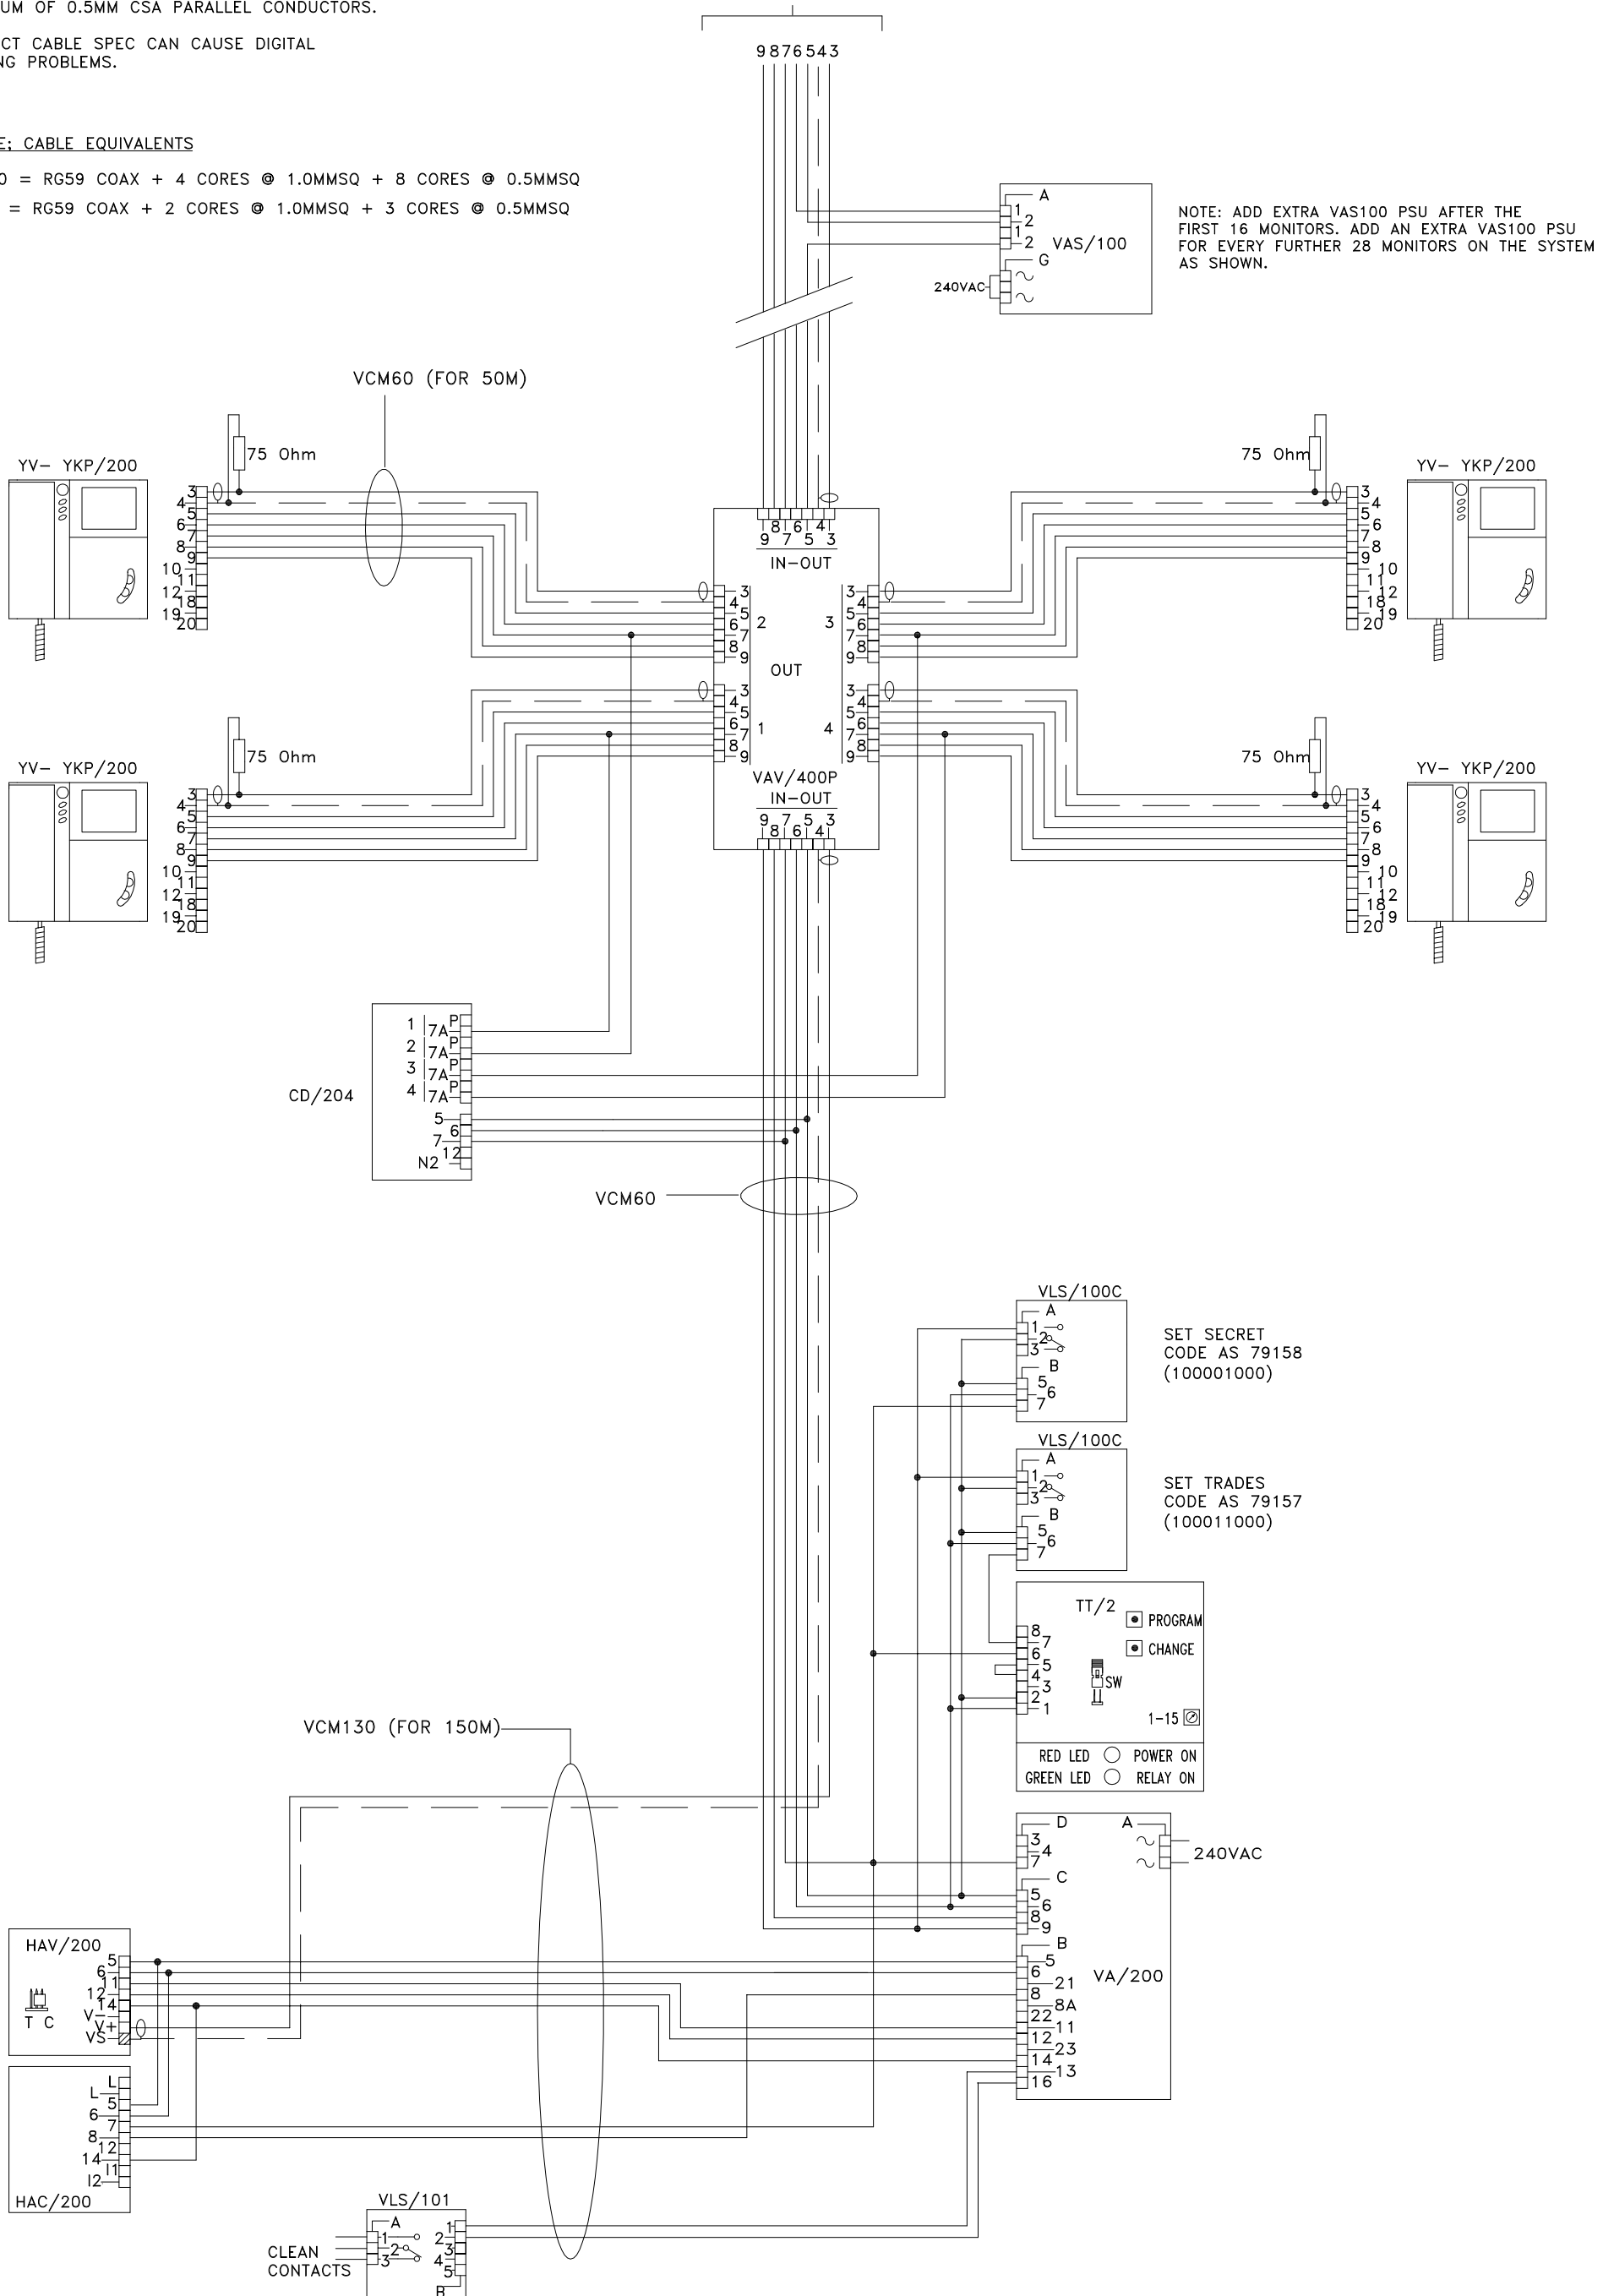

NOTE: ADD EXTRA VAS100 PSU AFTER THE  
FIRST 16 MONITORS. ADD AN EXTRA VAS100 PSU  
FOR EVERY FURTHER 28 MONITORS ON THE SYSTEM  
AS SHOWN.

SET SECRET  
CODE AS 79158  
(100001000)

SET TRADES  
CODE AS 79157  
(100011000)

TT/2

PROGRAM

CHANGE

SW

1-15

RED LED  POWER ON

GREEN LED  RELAY ON

BPT (UK) LTD.  
HERTS. ENGLAND

PREPARED FOR  
INSTALLER INFORMATION

DATE: 07/09/05

DRAWN: RC

REVISED:

DRAWING TITLE:

1 X DIGITAL TARGHA MONOCHROME VIDEO ENTRY PANEL,  
TRADES, CODED ENTRY & LYNEA VIDEO MONITORS

DRAWING No: B-XT1YNCTTVL(B)