



RISER DISTRIBUTION


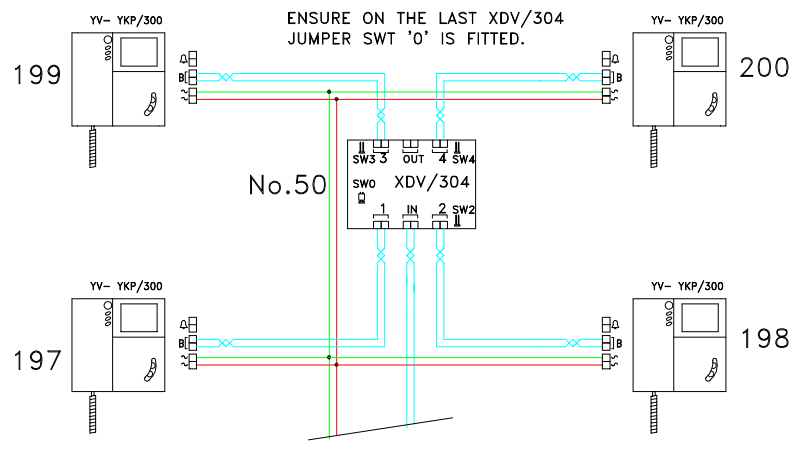


INSTALLER
1x VAS/100 IS REQUIRED FOR EVERY 50 MONITORS INSTALLED.

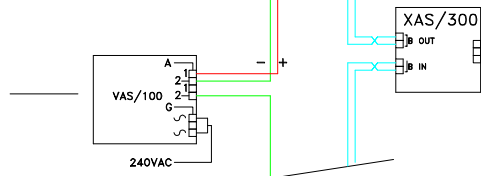


INSTALLER
1x XAS/300 IS REQUIRED FOR EVERY 100 MONITORS INSTALLED OR FOR EVERY 1000M OF CABLE USED. (2x XAS/300 MAX)


DISTRIBUTORS BETWEEN

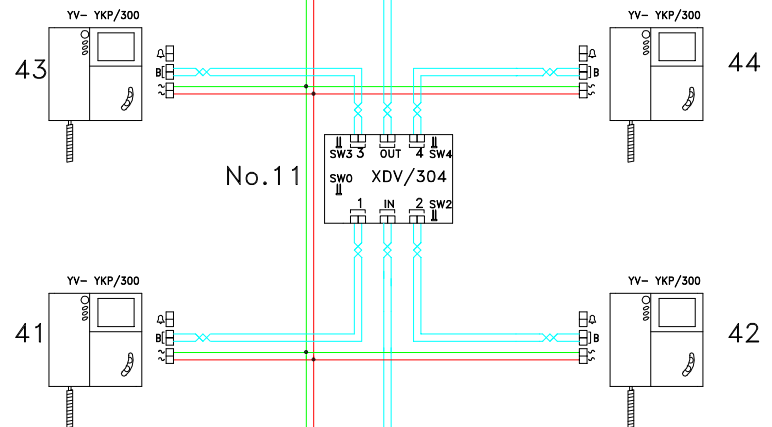


INSTALLER
1x XDV/300A IS REQUIRED FOR EVERY 10x XDV/304 INSTALLED

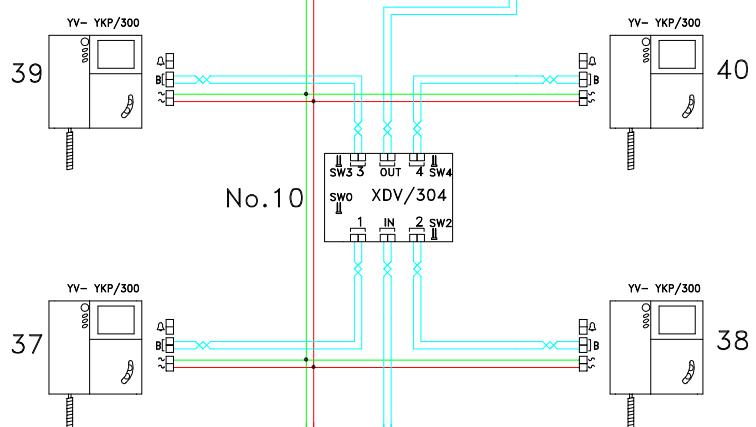

DISTRIBUTORS 2-9 BETWEEN

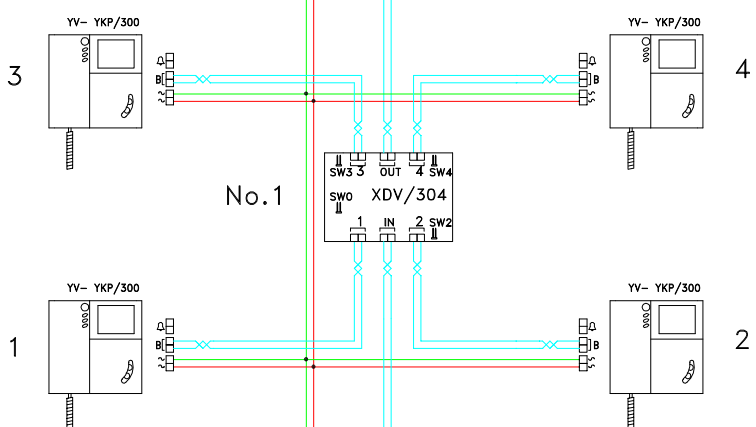


4 PAIR CAT5 + 2 CORES @ 1.0MMSQ

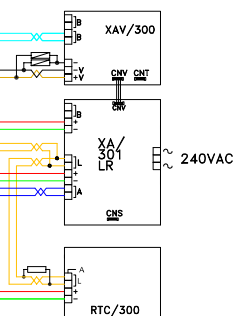


1. IT IS VITAL THAT THE CLOSING RESISTANCES SHOWN ON THE DRAWING AS 56R & 120R ARE CONNECTED AS INDICATED.

2. THE TWISTED PAIRS MUST NOT BE UNTWISTED TO SIMPLIFY INSERTION INTO TERMINALS.. KEEP THEM TWISTED TOGETHER ALL THE WAY INTO THE TERMINALS



TARGHA - DIGITAL

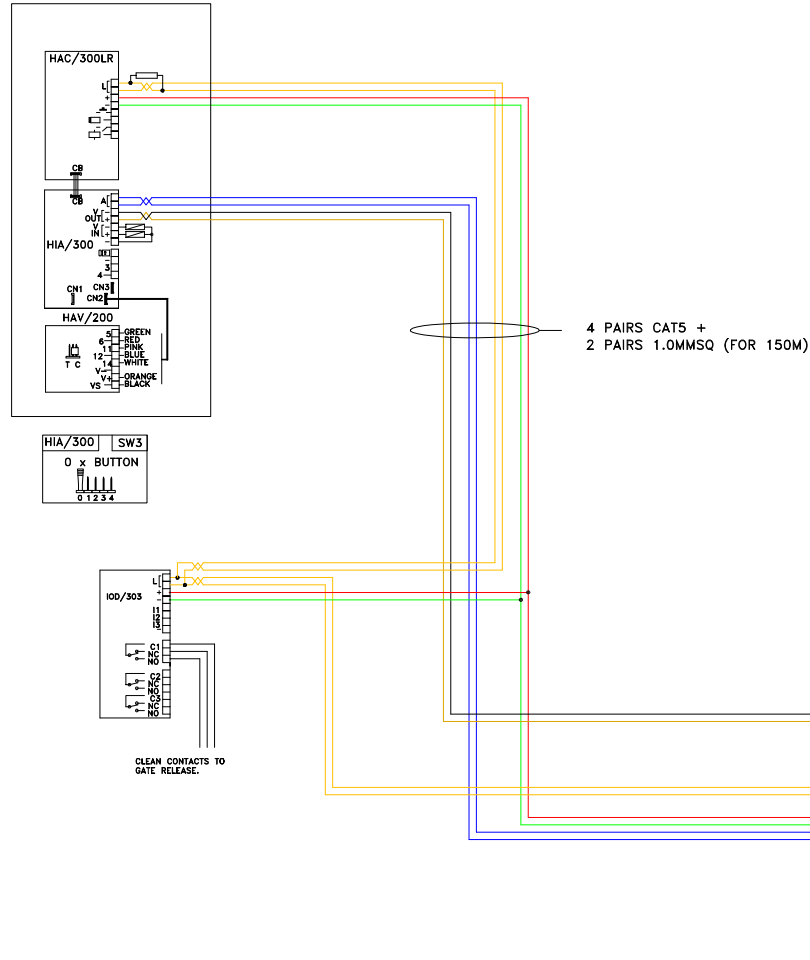

BPT (UK) LTD. HERTS. ENGLAND	PREPARED FOR INSTALLER INFORMATION	DATE: 21/07/08 REVISED:	DRAWN: RC
DRAWING TITLE: 1 X SYSTEM 300 DIGITAL VIDEO ENTRY PANEL WITH TRADES & 200 LYNEA MONITORS IN A SINGLE RISER		DRAWING No: C-XT1YNCTT	