

Art. 4800


Digital Codelock Unit Module
Modulo Tastiera digitale



INSTALLATION INSTRUCTION

CODELOCK UNIT MODULES

Art.4800



This module has on the front a 12 stainless steel button keypad (keys from "0" to "9" plus "ENTER" and "CLEAR"), 2 LEDS for operation signalling, the keypad illumination LEDs and a mirror stainless steel front plate (standard version). Codelock unit module has 3 built-in relays that allow to enable up to 3 services (door-open, gate-open etc.) by typing the programmed secret codes. Acoustic and visual (green and red front LEDs) signals facilitate the use and the programming operations. This module can be used individually or combined with other modules on an audio or video door entry systems.

MAIN FEATURES

- 3C, NC, NO relay outputs (24Vac/dc – 5A max);
- 3 Programmable secret codes (one for each relay);
- Each relay can be set to be activated for a specific time (01 to 99 seconds) or to work as latch;
- Two active low inputs to command directly the relay 1 and 2;
- Programming menu guarded by a 4-8 digit programmable secret code;
- Visual and Acoustic signal during operating and programming;
- Keypad illumination LEDs;
- 3 relé con contatti C, NC, NO (24Vac/dc – 5A max);
- 3 Codici programmabili (uno per ogni relé);
- Ciascun relé può essere programmato per l'attivazione temporanea (01-99 secondi) o per il funzionamento a comutazione;
- 2 ingressi attivo basso per comandare direttamente i relé 1 e 2;
- Menù di programmazione protetto da un codice segreto programmabile;
- Segnali acustici e visivi durante il funzionamento;
- LED di illuminazione e tastiera

GENERAL DIRECTIONS FOR INSTALLATION



In order to achieve the best results from the schematics described it is necessary to install only original VIDEX equipment, strictly keeping to the items indicated on each schematic and follow these General Directions for Installation:

- The system must be installed according to national rules in force in any case the running of cables or any intercom unit must be carried out separately from the mains;
- All multipair cables should be compliant to CW1308 specification (0.5mm twisted pair telephone cable).
- Cables for speech line and service should have a max resistance of 10 Ohm
- Lock release wires should be doubled up (Lock release wires and power supply wires should have a max resistance of 3 Ohm);
- The cable sizes above can be used for distances up to 50m. On distances above 50m the cable sizes should be increased to keep the overall resistance of the cable below the RESISTANCES indicated above;
- Double check the connections before power up;
- Power up the system then check all functions.

NORME GENERALI D'INSTALLAZIONE

Per eseguire una corretta installazione è necessario impiegare esclusivamente parti VIDEX, seguire con scrupolo quanto indicato negli schemi di collegamento e tenere presenti le norme generali d'installazione:

- Realizzare gli impianti secondo le vigenti normative nazionali ed in ogni caso si consiglia di prevedere, per i conduttori dell'impianto, una canalizzazione distinta da quella della linea elettrica (vedi paragrafo seguente per il collegamento alla linea elettrica e l'installazione dell'alimentatore);
- Impiegare conduttori con sezioni tali da avere:
- resistenza complessiva inferiore a 10 Ohm per quelli della linea fonica e di comando;
- resistenza complessiva inferiore a 3 Ohm per quelli della serratura e di alimentazione;
- Verificare le connessioni prima di dare alimentazione all'impianto;
- Alimentare l'impianto ed eseguire il collaudo verificandone tutte le funzioni

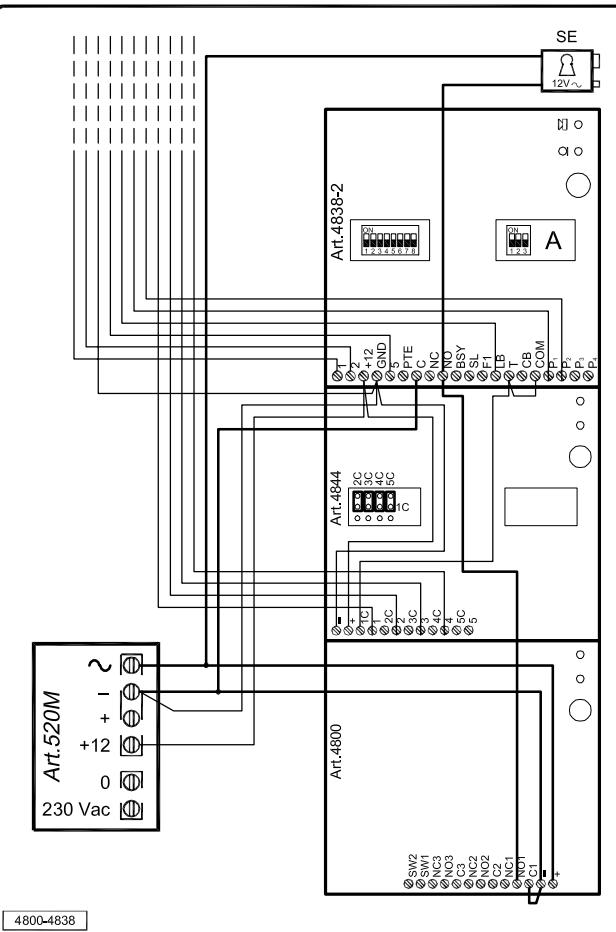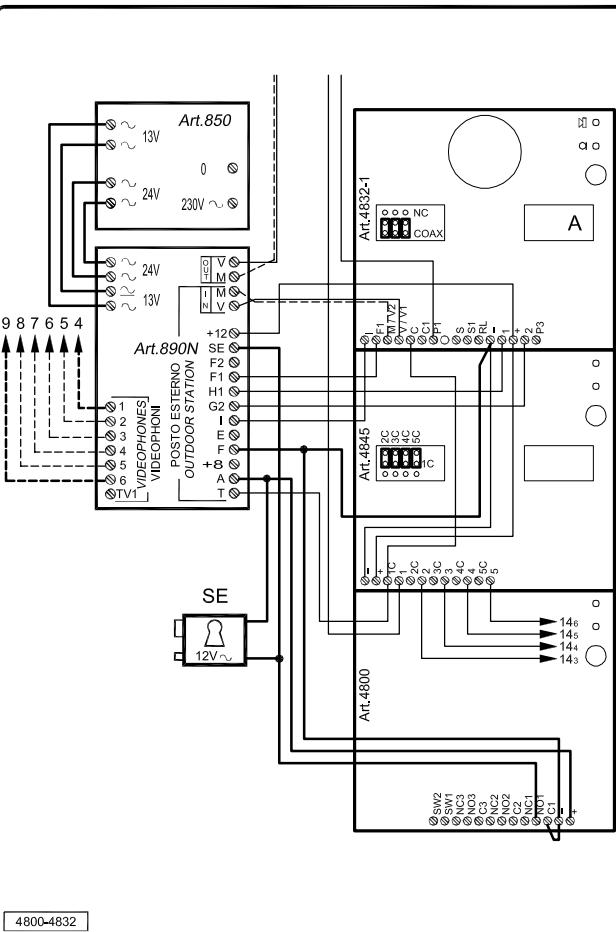

4800-4838

INFORMAZIONI ASSISTENZA CLIENTI

Clienti di tutti i Paesi

VIDEX Security LTD

www.videx-security.com

Tech Line 0191 224 3174

Fax 0191 224 1559

Fax +39 0734 631699

Fax +39 0734 632475

The product is CE marked demonstrating its conformity and is for distribution within all member states of the EU with no restrictions.

This product follows the provisions of the European Directives 89/336/EEC - 92/31/EEC (EMC),

73/23/EEC (LVD) and 93/68/EEC (CE marking).

4800-4832

CUSTOMER SUPPORT INFORMATION

All Countries Customers

VIDEX Security LTD

www.videx-security.com

Tech Line 0191 224 3174

Fax 0191 224 1559

Fax +39 0734 631699

Fax +39 0734 632475

The product is CE marked demonstrating its conformity and is for distribution within all member states of the EU with no restrictions.

This product follows the provisions of the European Directives 89/336/EEC - 92/31/EEC (EMC),

73/23/EEC (LVD) and 93/68/EEC (CE marking).

FIG.1A

Buzzer Back EMF

When using intercoms with a buzzer call (Art.924/926, SMART12, 31012, 31012/3, 30012 and 30212), add one 0.1uF capacitor between terminals 6 and 3.

Utilizzando citofoni con chiamata su buzzer (Art.924/926, SMART12, 31012, 31012/3, 30012 e 30212), inserire un condensatore da 0,1uF tra i morselli 6 e 3.

Rev.1.1

FIG.1B

Buzzer Protection da Disturbi

Utilizzando citofoni con chiamata su buzzer (Art.924/926, SMART12, 31012, 31012/3, 30012 e 30212), inserire un condensatore da 0,1uF tra i morselli 6 e 3.

Rev.1.1

FIG.1C

Azionamento Serratura – Protezione dai Disturbi

Azionamento della serratura L'azionamento della serratura può provocare degli spike, per evitare tale inconveniente si consiglia di collegare tra i terminali della serratura un condensatore (Fig.1A) o un diodo (Fig.1B) a seconda che la serratura sia in alternata o in continua.

Rev.1.1

FIG.1D

Lock Release Back EMF Protection

A capacitor must be fitted across the terminals on AC lock release (Fig.1A) and a diode must be fitted across the terminals on a DC lock release (Fig.1B) to suppress back EMF voltages. Connect the components to the lock releases as shown in figures.

Rev.1.1

FIG.1E

VIDEX Security LTD

www.videx-security.com

Tech Line 0191 224 3174

Fax 0191 224 1559

Fax +39 0734 631699

Fax +39 0734 632475

Rev.1.1


PROGRAMMING (SEE ALSO THE RELEVANT FLOW CHART)

- Enter the "MASTER CODE", first time type six times "1" (111111 factory preset) and press "ENTER" (The red LED will illuminate);
- Confirm "MASTER CODE" (typing again the same) or type the new one (4 to 8 digits) then press "ENTER" (Melody). Press twice the "ENTER" button without changing the "MASTER CODE"; will exit from the programming;
- Enter the code (4 to 8 digits) to enable "RELAY 1" or leave the existing code then press "ENTER" (Melody);
- Enter the "RELAY 1" operation time (2 digits 01 to 99 I.E. 05=5 seconds, 00= remain open time) or leave the existing time then press "ENTER" (Melody);
- Enter the code (4 to 8 digits) to enable "RELAY 2" or leave the existing code then press "ENTER" (Melody);
- Enter the "RELAY 2" operation time (2 digits 01 to 99 I.E. 05=5 seconds, 00= remain open time) or leave the existing time then press "ENTER" (Melody);
- Enter the code (4 to 8 digits) to enable "RELAY 3" or leave the existing code then press "ENTER" (Melody);
- Enter the "RELAY 3" operation time (2 digits 01 to 99 I.E. 05=5 seconds, 00= remain open time) or leave the existing time then press "ENTER" (Melody);
- The System is ready to use (the red LED will be off).

Programming Notes

- After the confirmation of an entered data by pressing the "ENTER" button, by pressing twice the same button you can exit from the programming.
- RETURN SYSTEM TO PRESET MASTER FACTORY CODE**
- Turn off power to code lock;
- Keep "ENTER" button pressed while turning back on the power;
- Release "ENTER" button;
- The master code is now set at "111111" (six times one).

CODELOCK UNIT PROGRAMMING FLOW-CHART

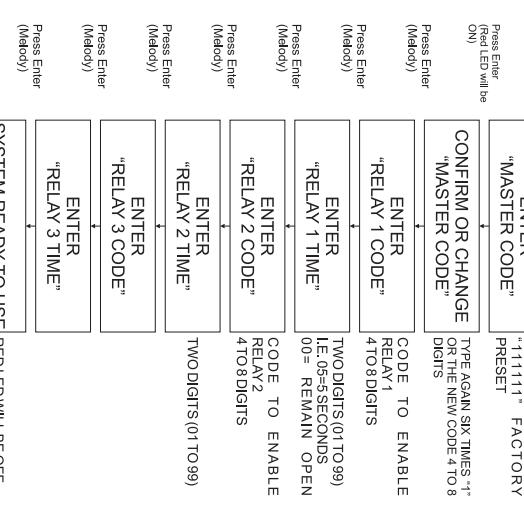

PROGRAMMAZIONE (VEDI RELATIVO DIAGRAMMA DI FLUSSO)

- Digitare il "MASTER CODE", 6 volte "1" (111111 impostazione di fabbrica) e premere "ENTER" (il LED rosso si accende);
- Confermare il "MASTER CODE" (digitando nuovamente) o digitare uno nuovo (da 4 ad 8 cifre) quindi premere "ENTER" (segnale acustico). Premendo due volte "ENTER" senza modificare il "MASTER CODE" si esce dalla programmazione;
- Digitare il codice di attivazione (da 4 ad 8 cifre) del "RELÈ 1" quindi premere "ENTER" (segnale acustico);
- Digitare il tempo d'attivazione del "RELÈ 1" (2 cifre da 01 a 99 Es 05-5 secondi 00=Commutazione di stato) quindi premere "ENTER" (segnale acustico);
- Digitare il codice di attivazione (da 4 ad 8 cifre) del "RELÈ 2" quindi premere "ENTER" (segnale acustico);
- Digitare il tempo d'attivazione del "RELÈ 2" quindi premere "ENTER" (segnale acustico);
- Digitare il codice di attivazione (da 4 ad 8 cifre) del "RELÈ 3" quindi premere "ENTER" (segnale acustico);
- Digitare il tempo di funzionamento del "RELÈ 3" quindi premere "ENTER" (segnale acustico);
- Il sistema è pronto all'uso (il LED rosso si spegne).


Note di Programmazione

- Dopo aver confermato l'inserimento di un dato premendo il tasto "ENTER", premendolo nuovamente per due volte consecutive, si esce dalla programmazione.



RIPORTARE L'UNITÀ ALLE IMPOSTAZIONI DI FABBRICA

- Togliere l'alimentazione alla tastiera;
- Tenendo premuto il tasto "ENTER", dare nuovamente alimentazione;
- Riaccendere il tasto "ENTER";
- Il codice master è nuovamente impostato a "111111" (sei volte uno).

FLOW-CHART DI PROGRAMMAZIONE TASTIERA DIGITALE

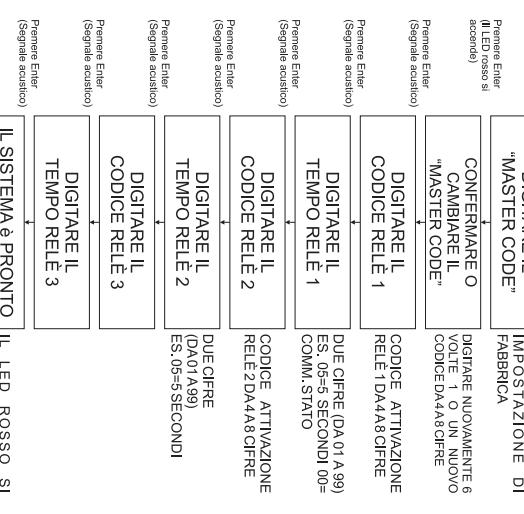

TERMINALS:

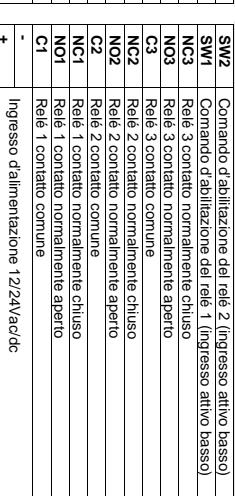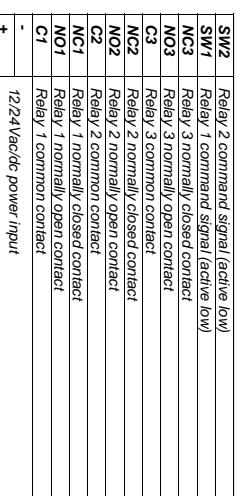

MORSETTIERA:

SW1	Relay 2 command signal (active low)
SW1	Command d'abilitazione del relè 1 (ingresso attivo basso)
NC1	Relay 3 normally closed contact
NC3	Relay 3 normally open contact
NO3	Relay 3 normally open contact
NO2	Relay 2 normally closed contact
NO2	Relay 2 normally open contact
C2	Relay 2 common contact
C2	Relay 2 common contact
NO1	Relay 1 normally closed contact
NO1	Relay 1 common contact
C1	Relay 1 normally open contact
C1	Relay 1 common contact
+	12/24Vac/dc power input
+	12/24Vac/dc power input
+	Ingresso d'alimentazione 12/24Vac/dc
+	Ingresso d'alimentazione 12/24Vac/dc

TECHNICAL SPECIFICATION


Power Supply: 12/24 Vac/dc - 2A
Working Temperature: -30mA max
-10+50°C

INSTALLATION DIAGRAMS

SPECIFICHE TECNICHE

Tensione d'alimentazione: 12/24 Vac/dc
Assorbitamento: 30mA max
Temperatura di lavoro: -10+50°C

SCHEMI DI INSTALLAZIONE

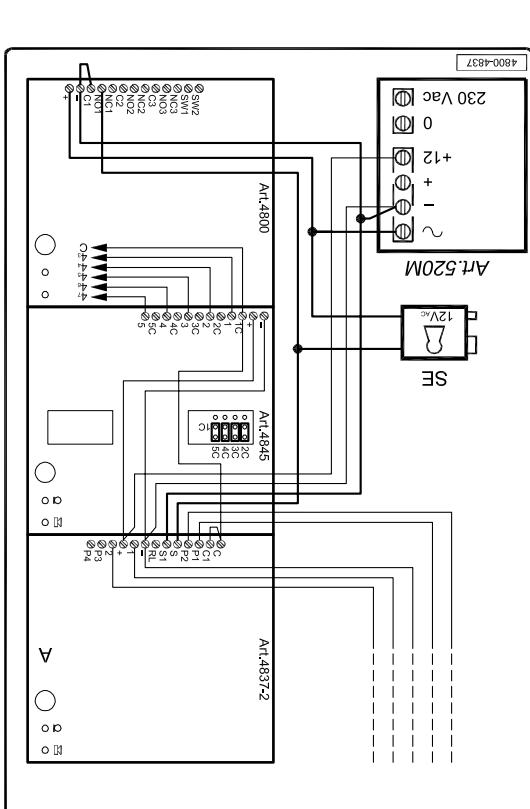

- Operation Notes**
- To operate relays together, set the same code for each relay;
- If a wrong code is entered, the system will lock out for 5 seconds which will increase each time a wrong code is entered. The system will operate only when the correct code is entered;
- If the code is right, the green LED will illuminate and the relay will operate for the programmed time;
- If a wrong code is "ENTER"ed a continuous melody will sound for 4 or more seconds, according to the number of mistakes;
- To switch off any relay while operating type in the relevant code then press the "CLEAR" button;

OPERATION

- Type in the programmed code and press "ENTER".

- If the code is right, the green LED will illuminate and the relay will operate for the programmed time;

- If a wrong code is "ENTER"ed a continuous melody will sound for 4 or more seconds, according to the number of mistakes;

- To switch off any relay while operating type in the relevant code then press the "CLEAR" button;

- To operate relays together, set the same code for each relay;
- If a wrong code is entered, the system will lock out for 5 seconds which will increase each time a wrong code is entered. The system will operate only when the correct code is entered;
- If the code is right, the green LED will illuminate and the relay will operate for the programmed time;
- If a wrong code is "ENTER"ed a continuous melody will sound for 4 or more seconds, according to the number of mistakes;
- To switch off any relay while operating type in the relevant code then press the "CLEAR" button;

Note di Funzionamento

- Per far funzionare i relè contemporaneamente, impostare lo stesso codice di attivazione per ciascun relè.
- Se il codice è corretto, il LED verde si accende ed il relè si attiva per il tempo programmato.
- Se il codice è errato, una melodia lo segnala per 4 secondi o più in base al numero di digitazioni errate.
- Per disattivare uno dei relè mentre è in funzione, digitare il relativo codice quindi premere il tasto "CLEAR".

FUNZIONAMENTO

- Digitare il codice segreto o premere "ENTER".

- Se il codice è corretto, il LED verde si accende ed il relè si attiva per il tempo programmato.

- Se il codice è errato, una melodia lo segnala per 4 secondi o più in base al numero di digitazioni errate.

- Per disattivare uno dei relè mentre è in funzione, digitare il relativo codice quindi premere il tasto "CLEAR".