


NOTE:
THIS DRAWING INDICATES AND ASSUMES THE USE OF
A MINIMUM OF 0.5MM CSA PER CORE.
ENSURE ALL CONTROL EQUIPMENT IS LOCATED CENTRALLY.

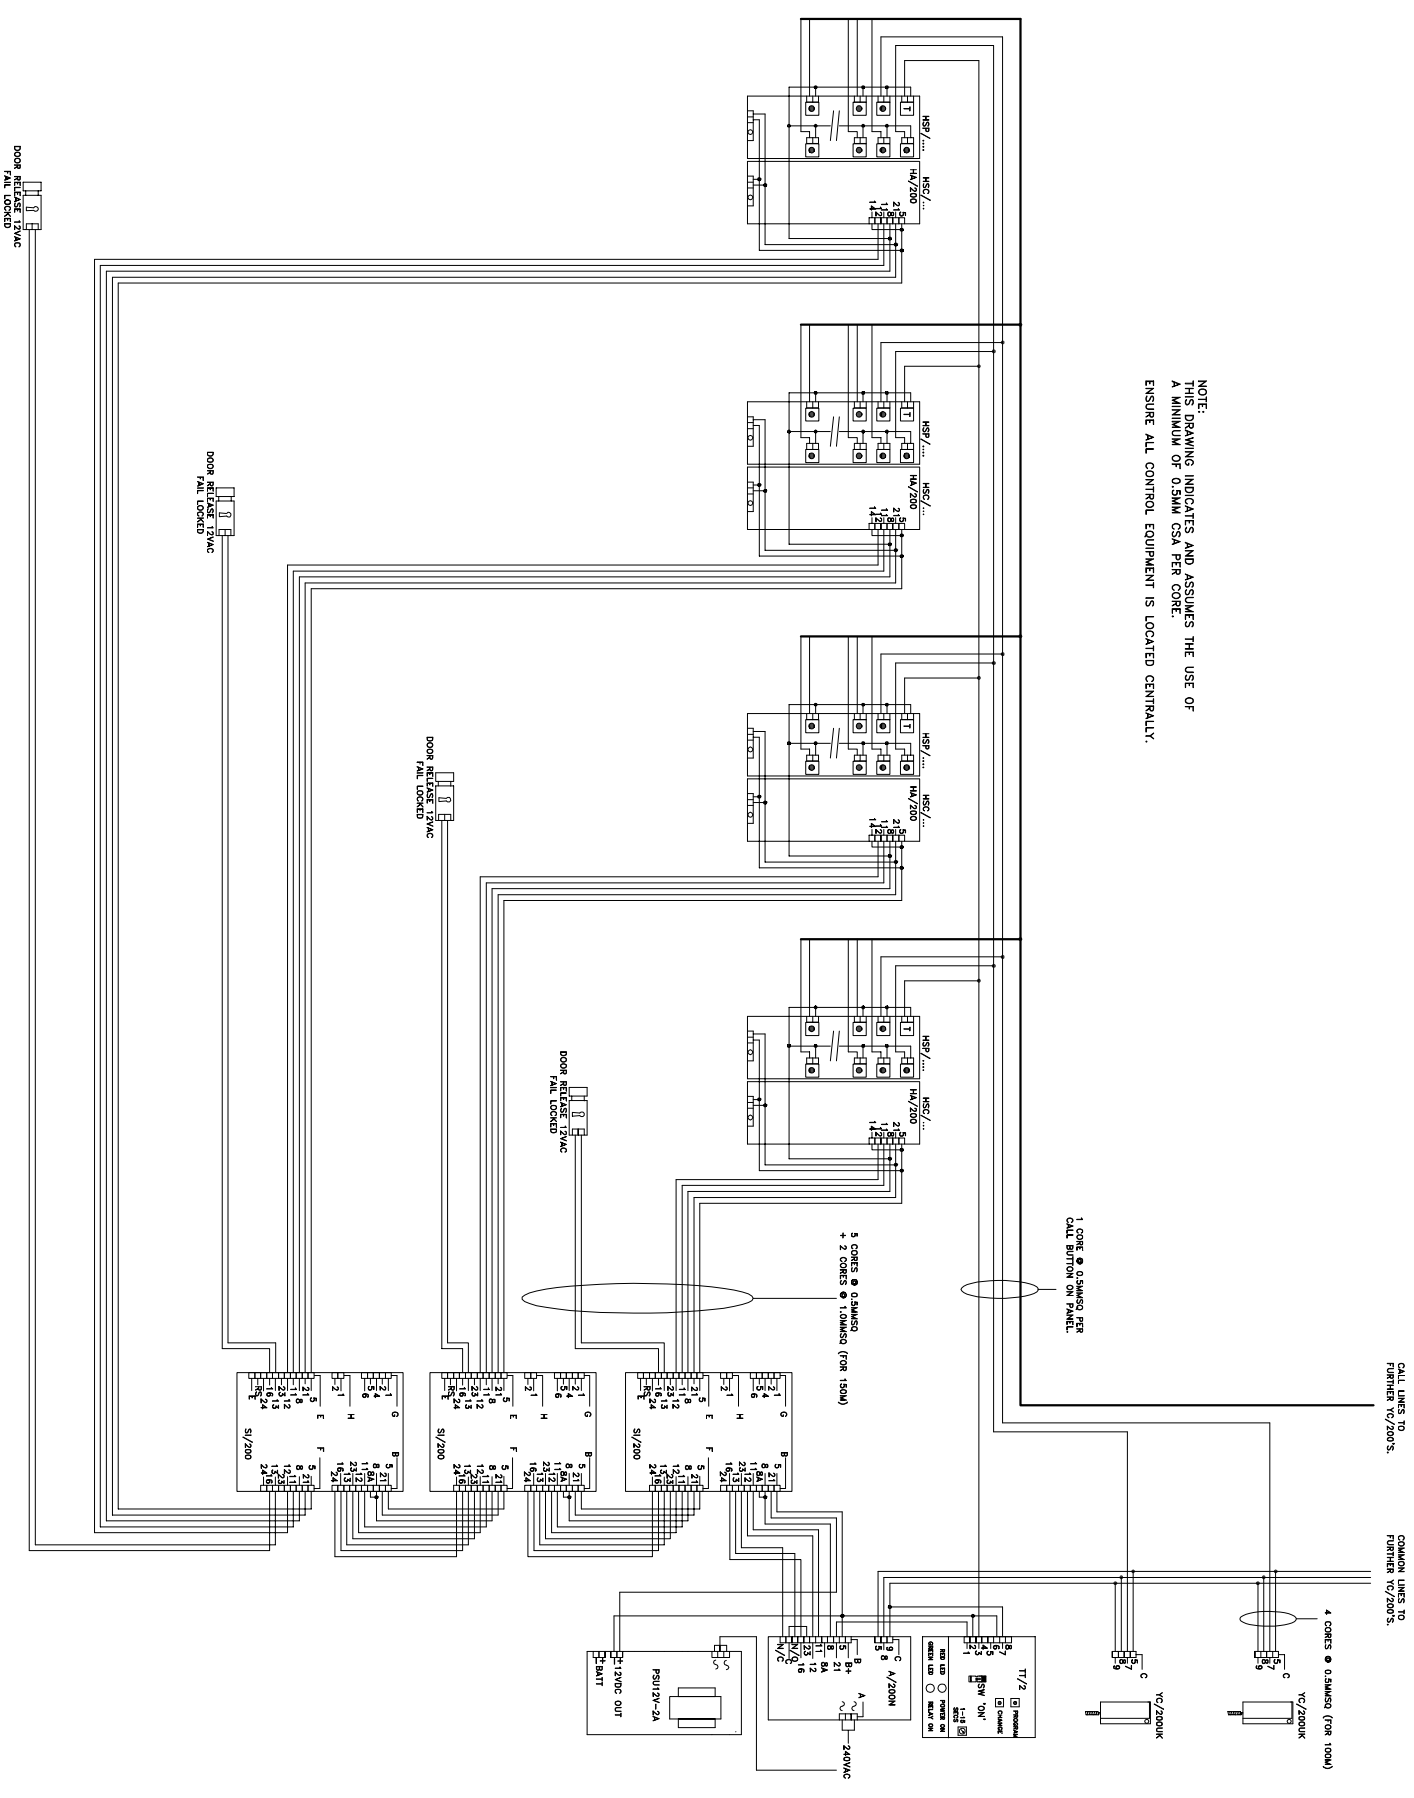

BPT (UK) LTD. HERTS. ENGLAND	PREPARED FOR INSTALLER INFORMATION	DATE: 19/07/07	DRAWN:RC
DRAWING TITLE: 4 X MULTI BUTTON TARGHA AUDIO ENTRY PANELS WITH TRADES & LYNEA HANDSETS		REVISED:	
		DRAWING No: E-NI4YALTT	

CALL LINES TO FURTHER VC/200'S.
COMMON LINES TO FURTHER VC/200'S.

4 CORES @ 0.5MMSQ (FOR 100A)
VC/200UK

VC/200UK

1 CORE @ 0.5MMSQ PER
CALL BUTTON ON PANEL

3 CORES @ 0.5MMSQ (FOR 150A)
2 CORES @ 1.0MMSQ (FOR 150A)

DOOR RELEASE 17VAC
FAIL LOCKED

DOOR RELEASE 17VAC
FAIL LOCKED

DOOR RELEASE 17VAC
FAIL LOCKED

DOOR RELEASE 17VAC
FAIL LOCKED