


NOTE:
 ENSURE THAT THE CORRECT DIP SWITCHES ARE SET AND THAT THE IT/200 IS PROGRAMMED AS PER ITS MANUAL. (IE. 29-0 & 63-1)
 ENSURE THAT THE BT LINE 'IN' IS AN ANALOGUE LINE NOT ISDN.

NOTE:
 ALL CONTROL EQUIPMENT MUST BE CENTRALLY LOCATED.

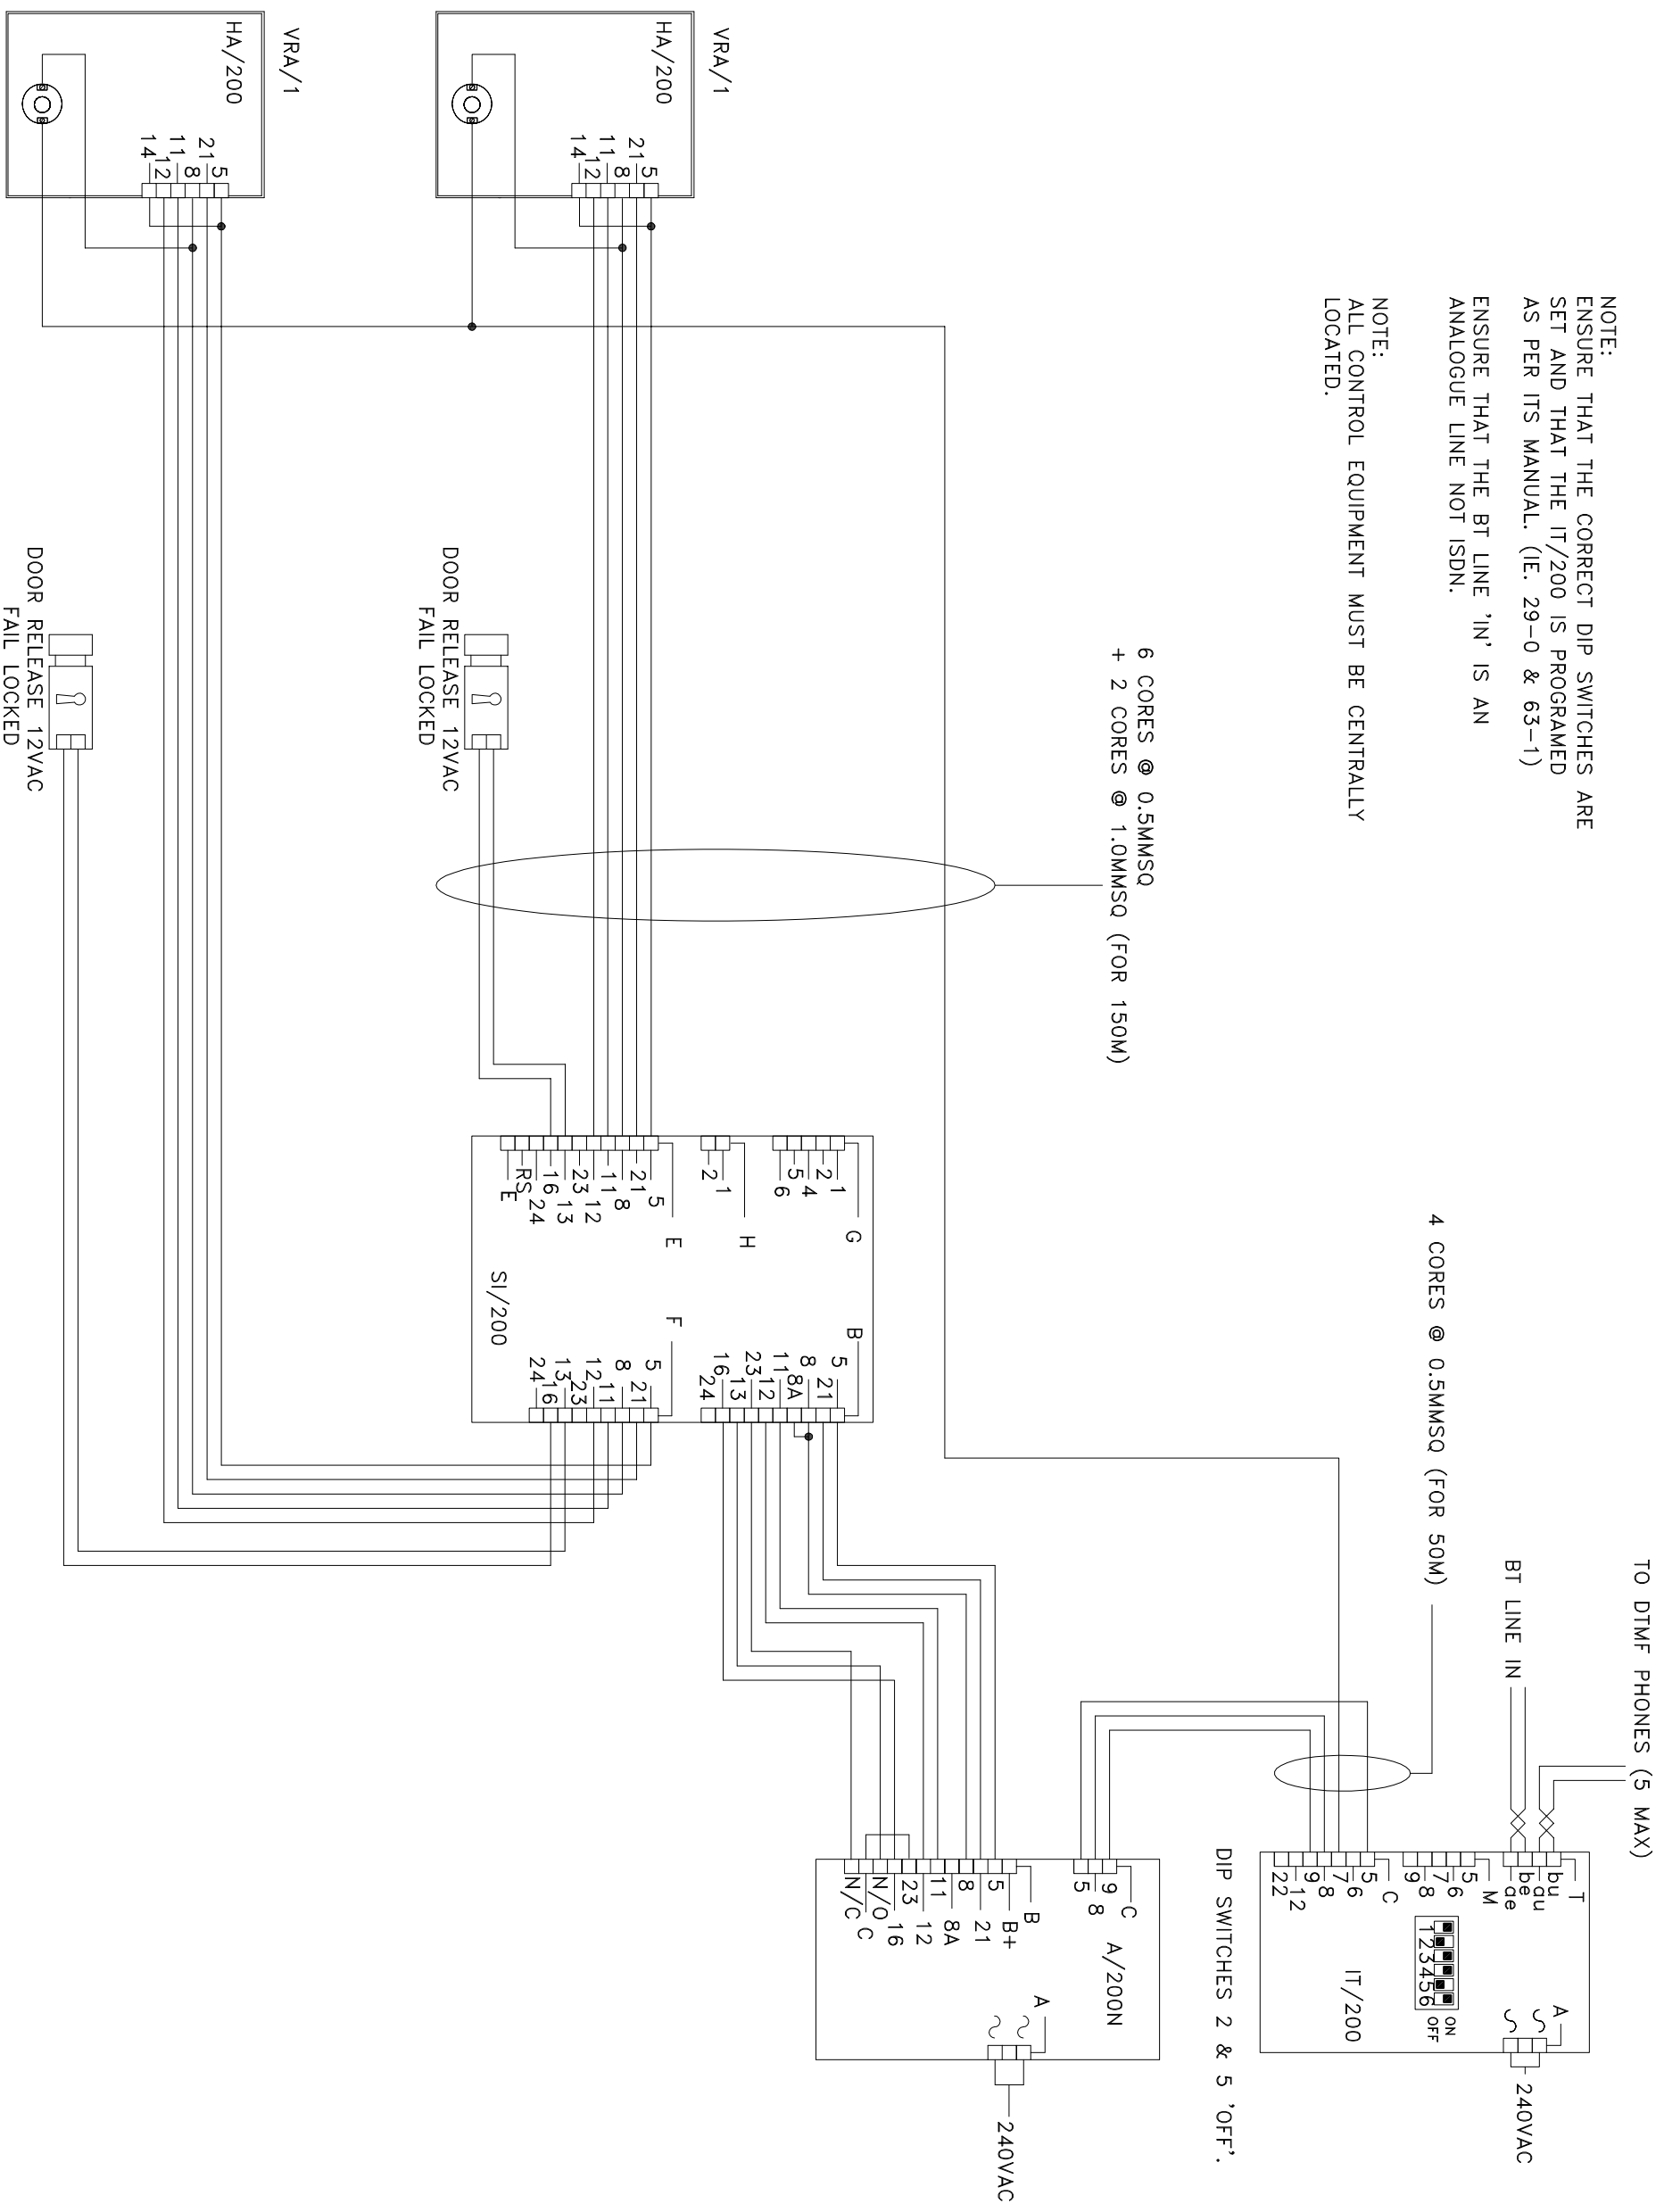

BPT (UK) LTD. HERTS. ENGLAND	PREPARED FOR	
	INSTALLER INFORMATION	
DRAWING TITLE:	2 X 1 BUTTON VR AUDIO ENTRY PANEL & 1 BT TELEPHONE INTERFACE	
	DATE: 18/09/06	DRAWN:RC
	REVISED:	
	DRAWING No: E-1V211L	